


Notes:

- Line taps shall be made in the galvanized trough by the electrical contractor.
- Weatherproof fittings required.
- Two disconnects could be substituted with (1) disconnect. All disconnects shall have over current protection.
- Wire shall be sized to total disconnect sizes.
- Neutral(s) may be reduced no more than two sizes on residential application. No reduction of the neutral(s) is allowed on commercial application.
- Member shall contact Bluebonnet Electric to determine the secondary conduit location. Conduit to be installed 36" to the side of transformer. Call 800-842-7708 to schedule an appointment.
- Bluebonnet will complete wiring into transformer. Have sufficient amount of wire for termination. Member shall install an additional 10' of wire for termination.
- All secondary connections to be made inside transformer by Bluebonnet.
- Bluebonnet to provide the CT's.
- Member assembly must remain unenclosed on exterior of structure.
- Member/Electrician shall coordinate with Bluebonnet personnel to install all conduit and the pulling of the secondary wire to the transformer. Member/Electrician shall notify Bluebonnet 48 hours in advance to schedule a time/date to perform the work.
- If additional trips are made to the site by Bluebonnet personnel, applicable fees may be applied.
- Member shall use a metal nipple. A straight or offset nipple is acceptable.

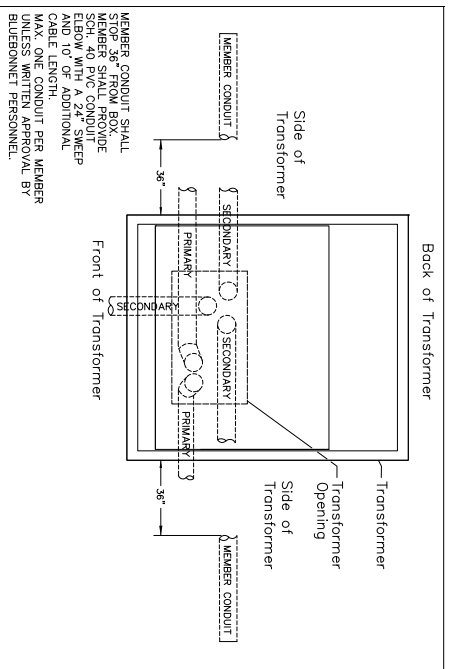


Single Phase Transformer Layout

FOR THE MEMBER'S SAFETY, WIRING INSTALLATION AND MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESC.

WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS.

Non-combustible walls = 5 feet
 Combustible walls: >75kVA = 10 feet
 >75kVA = 20 feet

Single Phase application, the CT's are located in the transformer the meter can be located on the meter rack installed and provided by Bluebonnet.

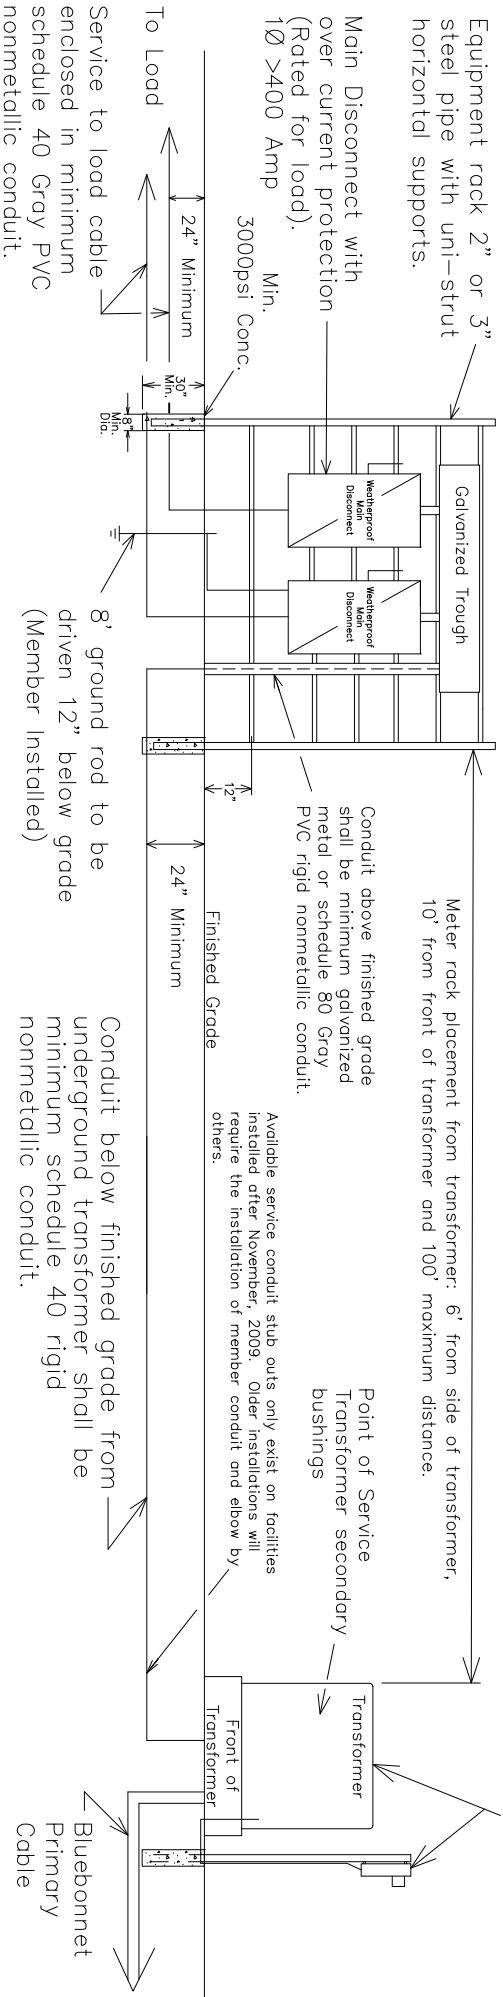

Latest update can be found at www.bluebonnetelectric.coop/myHome/electricServices/meterLoop.aspx



1 PHASE >400 AMP UNDERGROUND SERVICE WITH DISCONNECT ON RACK OR BUILDING.		Drawn By :	RG	Checked By :	MS COMMITTEE	Approved By :	TE
DATE	REVISIONS	Scale :	NONE	Date :	07-25-2016		MS-204A1