


NOTES:

1. Weatherproof fittings required
2. Bluebonnet pole must remain free of structures and private attachments other than meter loop riser assembly.
3. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.
4. A plaque or directory showing all disconnecting means per NEC 705.10.
5. Disconnect may be mounted on a building or other suitable structure.

See MS-102, MS-10115, Or MS-10119 For Meter Loop Specifications

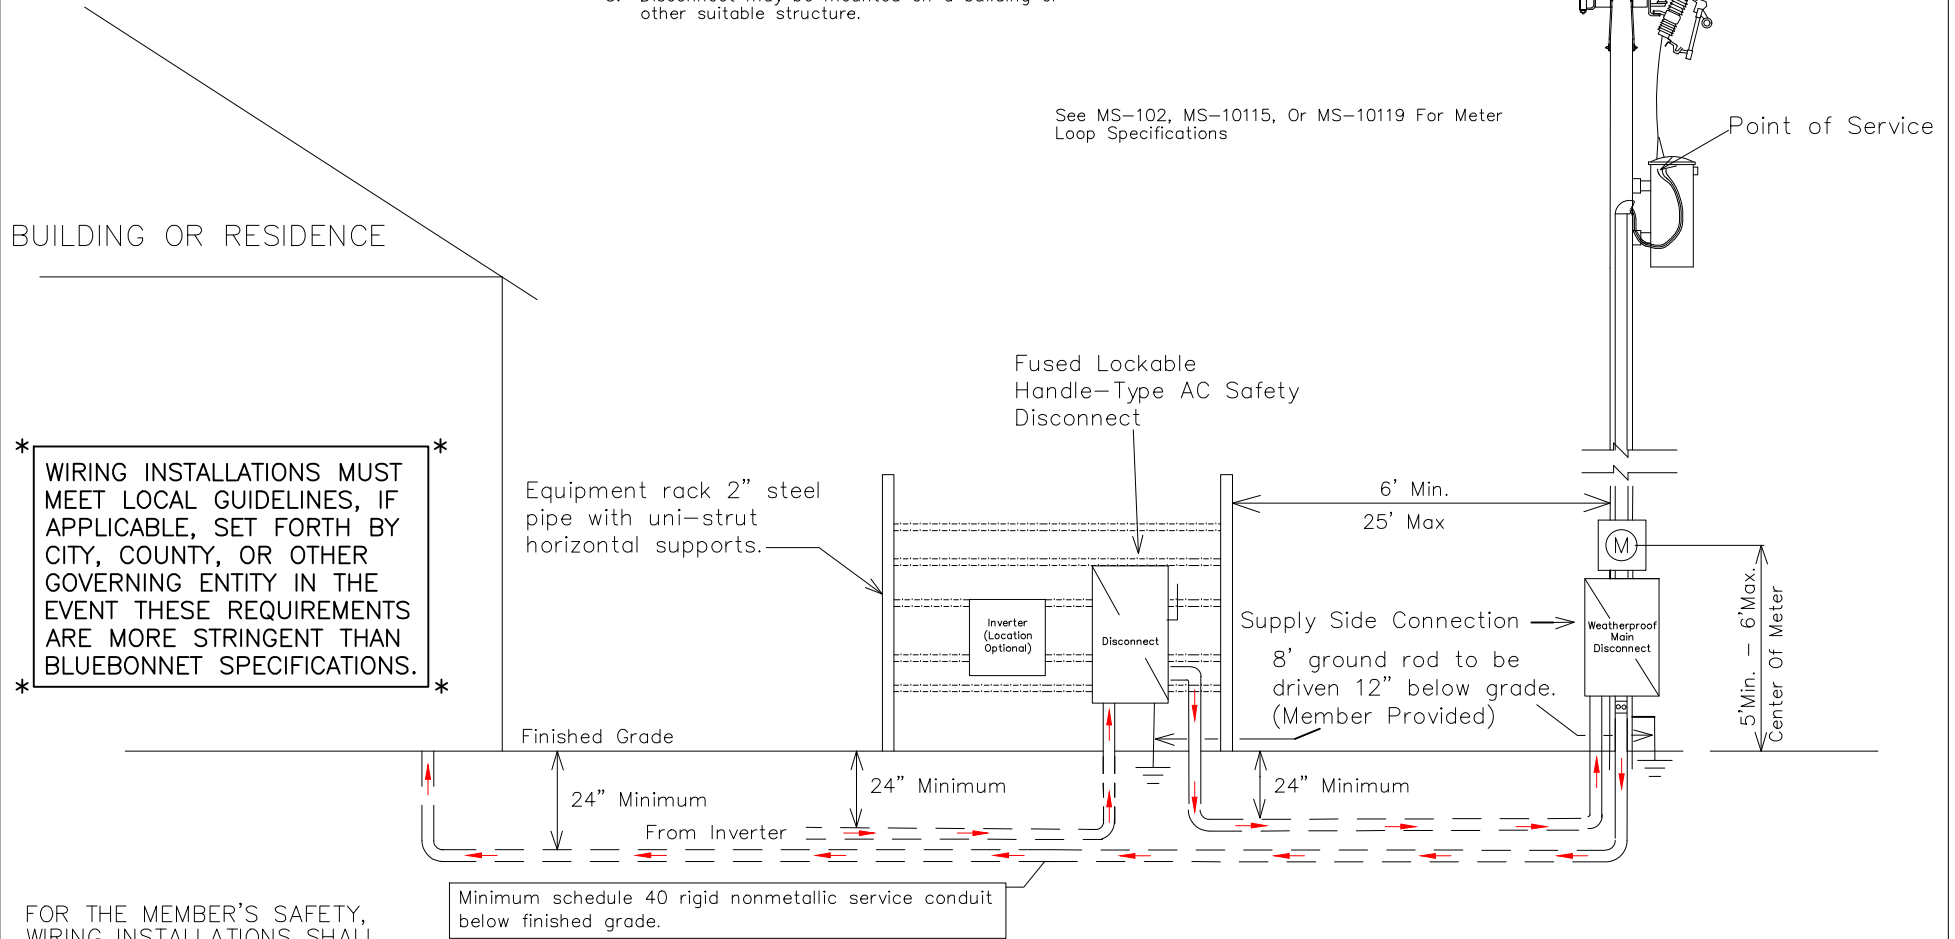

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESC.

Latest update can be found at www.bluebonnetelectric.coop



RENEWABLE INTERCONNECTION LESS THAN 50 kW AT METER ON POLE WITH LINE SIDE TAP

| DATE | REVISIONS |
|------|-----------|
| | |
| | |
| | |

Drawn By :

SD

Scale :

NONE

Checked By :

DER COMMITTEE

Date :

10-30-2018

Approved By :

TE

MS-502